

Aggarwal, Anil Kr.; Kumar, Sanjeev; Singh, Vikram; Garg, Tarun Kr.

## Article

# Markov modeling and reliability analysis of urea synthesis system of a fertilizer plant

Journal of Industrial Engineering International

## Provided in Cooperation with:

Islamic Azad University (IAU), Tehran

*Suggested Citation:* Aggarwal, Anil Kr.; Kumar, Sanjeev; Singh, Vikram; Garg, Tarun Kr. (2015) : Markov modeling and reliability analysis of urea synthesis system of a fertilizer plant, Journal of Industrial Engineering International, ISSN 2251-712X, Springer, Heidelberg, Vol. 11, pp. 1-14, <https://doi.org/10.1007/s40092-014-0091-5>

This Version is available at:

<https://hdl.handle.net/10419/157426>

### Standard-Nutzungsbedingungen:

Die Dokumente auf EconStor dürfen zu eigenen wissenschaftlichen Zwecken und zum Privatgebrauch gespeichert und kopiert werden.

Sie dürfen die Dokumente nicht für öffentliche oder kommerzielle Zwecke vervielfältigen, öffentlich ausstellen, öffentlich zugänglich machen, vertreiben oder anderweitig nutzen.

Sofern die Verfasser die Dokumente unter Open-Content-Lizenzen (insbesondere CC-Lizenzen) zur Verfügung gestellt haben sollten, gelten abweichend von diesen Nutzungsbedingungen die in der dort genannten Lizenz gewährten Nutzungsrechte.

### Terms of use:

*Documents in EconStor may be saved and copied for your personal and scholarly purposes.*

*You are not to copy documents for public or commercial purposes, to exhibit the documents publicly, to make them publicly available on the internet, or to distribute or otherwise use the documents in public.*

*If the documents have been made available under an Open Content Licence (especially Creative Commons Licences), you may exercise further usage rights as specified in the indicated licence.*



<http://creativecommons.org/licenses/by/2.0/>

# Markov modeling and reliability analysis of urea synthesis system of a fertilizer plant

Anil Kr. Aggarwal · Sanjeev Kumar ·  
Vikram Singh · Tarun Kr. Garg

Received: 20 March 2014 / Accepted: 21 October 2014 / Published online: 10 December 2014  
© The Author(s) 2014. This article is published with open access at Springerlink.com

**Abstract** This paper deals with the Markov modeling and reliability analysis of urea synthesis system of a fertilizer plant. This system was modeled using Markov birth–death process with the assumption that the failure and repair rates of each subsystem follow exponential distribution. The first-order Chapman–Kolmogorov differential equations are developed with the use of mnemonic rule and these equations are solved with Runge–Kutta fourth-order method. The long-run availability, reliability and mean time between failures are computed for various choices of failure and repair rates of subsystems of the system. The findings of the paper are discussed with the plant personnel to adopt and practice suitable maintenance policies/strategies to enhance the performance of the urea synthesis system of the fertilizer plant.

**Keywords** Reliability · Chapman–Kolmogorov differential equations · Markov birth–death process

## Introduction

The system reliability has great significance in recent years due to competitive environment. Reliability is defined as the ability of a system to perform the required function under stated conditions for a specified period of time. The reliability of a complex system can be obtained by either increasing the capacity of the system or providing sufficient redundant part(s) with perfect switch over devices. Kumar and Tewari (2008, 2009) presented a simulation model for evaluating the performance of CO-shift conversion system and urea decomposition system in a fertilizer plant. Dhillon and Singh (1981) and Kumar et al. (1989, 2007) used Markov model for performance analysis of paper and fertilizer plants. Arora and Kumar (1997) discussed the availability analysis of steam and powder generation systems of thermal power plants. Gupta and Tewari (2011) presented the availability model for a thermal power plant. Khanduja et al. (2012) presented the steady-state behavior and maintenance planning of bleaching system of a paper plant. Kumar and Tewari (2011) discussed the mathematical modeling and performance optimization of CO<sub>2</sub> cooling system of a fertilizer plant using the genetic algorithm. Dhople et al. (2014) provided a framework to analyze Markov reward models used in system performability analysis. Tewari et al. (2012) computed the steady-state availability and performance optimization for the crystallization unit of a sugar plant by using genetic algorithm. Kiilumen and Frisk (2014) developed a method to examine the long-term reliability of an anisotropic conductive adhesive (ACA)-attached polyethylene terephthalate (PET) flex-on-board (FOB) assembly for industrial application used in harsh environments. Ahmed et al. (2014) provided a risk-based stochastic modeling approach using a Markov decision process to

---

A. Kr. Aggarwal (✉)  
Rattan Institute of Technology and Management, Mundakati  
Chowk, Village Seveli, Hodal, Haryana, India  
e-mail: anil1995@rediffmail.com; anilpalwal@gmail.com

S. Kumar · V. Singh  
Mechanical Engineering Department, YMCA University of  
Science and Technology, Sec. 6, Faridabad, Haryana, India  
e-mail: getsan25@rediffmail.com

V. Singh  
e-mail: singhvikram77@gmail.com

T. Kr. Garg  
Mathematics Department, Satyawati College,  
Ashok Vihar, Delhi, India  
e-mail: tarungargdu@gmail.com

assess the availability of a processing unit, which is referred to as the risk-based availability Markov model (RBAMM). Kumar et al. (2011) discussed the performance analysis of the furnace draft air cycle of a thermal power plant. Kadiyan et al. (2012) discussed the availability and reliability analysis of an uncaser system for a brewery plant. Singh and Goyal (2013) presented a methodology to study the steady-state behavior of repairable mechanical biscuit shaping system pertaining to a biscuit-manufacturing plant. Kumar and Mudgil (2014) discussed the availability analysis of the ice cream-making unit of a milk plant.

The literature revealed that the methods used by the different authors involve complex computations and the problem of determining long-run or steady-state availability of the system has been extensively studied. In this paper, a numerical method, i.e., Runge–Kutta fourth-order method is used to compute the MTBF and reliability of the urea synthesis system of a fertilizer plant. The values of failure and repair rates of all the subsystems of urea synthesis system were collected from maintenance history sheets and discussion with maintenance personnel of a fertilizer plant situated at Panipat, Haryana (India). The fertilizer plant comprises many systems, viz. urea synthesis system, urea decomposition system, urea crystallization system, urea prilling system, etc. The urea synthesis system is important for a fertilizer plant. This paper has been organized into six sections. The present section is the introductory type including the concerned literature review. In second section presents the “[Mathematical aspects of reliability and availability](#)”, whereas the third section concerned with “[System description, assumptions and notations](#)”. In fourth section deals with “[Mathematical modeling of urea synthesis system](#)”. “[Performance analysis of the system](#)” concerns in the fifth section. Finally, sixth section deals with “[Discussion and conclusion](#)”.

## Mathematical aspects of reliability and availability

### Reliability

Reliability is the probability for failure-free operation of a system during a given interval of time, i.e., it is a measure of success for a failure-free operation. The reliability of a component may be calculated as:

$$R(t) = 1 - e^{-\alpha t}$$

where  $\alpha$  is the constant failure rate of the component (per hour) and  $t$  is the operation time (hour).

$$\text{Reliability} = e^{\left[-\frac{\text{Time}}{\text{MTBF}}\right]}$$

### Availability

Availability is the probability that a component or system is performing its required function at a given point in time when used under stated operating conditions. It is calculated by the ratio between lifetime and total time between failures of the equipment.

### Mean time between failures (MTBF)

MTBF is the amount of failures per million hours for a component. It is commonly used as a variable in reliability and maintainability analysis as

$$\text{MTBF} = \int_0^{\infty} R(t)dt = \int_0^{\infty} e^{-\beta t} dt = \frac{1}{\beta}.$$

### Markov approach

Arora and Kumar (1997), Bradley and Dawson (1998), Dhillon and Singh (1981), Kumar et al. (1993, 2007) and Bhamare et al. (2008) used the Markov approach for availability analysis of different process plants. According to Markov, if  $P_0(t)$  represents the probability of zero occurrences in time  $t$ , the probability of zero occurrences in time  $(t + \Delta t)$  is given by the Eq. (1)

$$P_0(t + \Delta t) = (1 - \alpha t) P_0(t). \quad (1)$$

Similarly,

$$P_1(t + \Delta t) = \beta \Delta t P_0(t) + (1 - \alpha \Delta t) P_1(t), \quad (2)$$

where  $\alpha$  is the failure rate and  $\beta$  is the repair rate of the component or subsystem respectively.

The Eq. (2) shows that the probability of one occurrence in time  $(t + \Delta t)$  is composed of two parts:

- probability of zero occurrences in time  $t$  multiplied by the probability of one occurrence in time interval  $\Delta t$  and
- probability of one occurrence in time  $t$  multiplied by the probability of no occurrences in the interval  $\Delta t$ .

After simplifying and taking  $\Delta t \rightarrow 0$ , the Eq. (2) is reduced to

$$P_1'(t) + \beta P_1(t) = \alpha P_0(t). \quad (3)$$

Using the concept used in Eq. (3), the equations for transient and steady states are derived.

## System description, assumptions and notations

### System description

The urea synthesis system comprises a compressor used to compress the carbon dioxide, two reciprocating pumps

used to boost the pressure of liquid ammonia and heaters used to heat ammonia gas. In this process, the CO<sub>2</sub> gas and liquid ammonia (NH<sub>3</sub>) available from the ammonia production process are fed to the urea synthesis reactor. In the reactor these gases react to form urea in gaseous form. The urea synthesis system comprises five subsystems arranged in series as (Fig. 1):

1. Subsystem A<sub>1</sub>: It has CO<sub>2</sub> booster compressor as a single unit arranged in series. Its failure causes the complete failure of the system.
2. Subsystem A<sub>2</sub>: It has CO<sub>2</sub> compressor as a single unit arranged in series. Failure of this subsystem causes the complete failure of the system.
3. Subsystem A<sub>3</sub>: It consists of three NH<sub>3</sub> pre-heaters units arranged in series. Failure of any one of these causes the complete failure of the system.
4. Subsystem H: It consists of four liquid ammonia feed pumps arranged in parallel. Two pumps remain operative in parallel and the other two in cold standby. Failure of three pumps at a time will cause complete failure of the system.
5. Subsystem L: It consists of three recycle solution feed pumps arranged in parallel. Failure of any one unit reduces the capacity of the system, but complete failure occurs when failure of all units takes place at a time.

**Assumptions**

- The failure and repair rates are constant over time, statistically independent of each other and there are no simultaneous failures among the subsystems as stated by Kumar and Kumar (2011).
- There are sufficient repair or replacement facilities, i.e., no waiting time to start the repairs. The failure or repair

of the system follows exponential distribution as stated by Srinath (1994).

- A repaired system is as good as new, performance-wise, as stated by Khanduja et al. (2008).
- The switchover devices used for standby subsystems are perfect.


**Notations**

○	Full working state of the system
◐	Reduced state of the system
◑	Failed state of the system
□	Probability of the system working with full capacity at time <i>t</i>
$P_0(t)$	Probability of the system in cold standby state
$P_1(t), P_6(t)$	Probability of the system in reduced capacity state
$P_2(t)$ to $P_5(t), P_7(t), P_8(t)$	Probability of the system in failed state
$P_9(t)$ to $P_{41}(t)$	Mean failure rates of A <sub>1</sub> , A <sub>2</sub> , A <sub>3</sub> , H and L, respectively
$\alpha_i, i = 1,2,3,4,5$	Mean repair rates of A <sub>1</sub> , A <sub>2</sub> , A <sub>3</sub> , H and L, respectively, and derivative w.r.t. <i>t</i>
$\beta_i, i = 1,2,3,4,5$	
$d/dt$	

**Mathematical modeling of the urea synthesis system**

The mathematical modeling of the system is carried out using simple probabilistic considerations and Chapman–Kolmogorov differential equations are developed based on Markov birth–death process. The Chapman–Kolmogorov

**Fig. 1** Flow diagram of the urea synthesis system

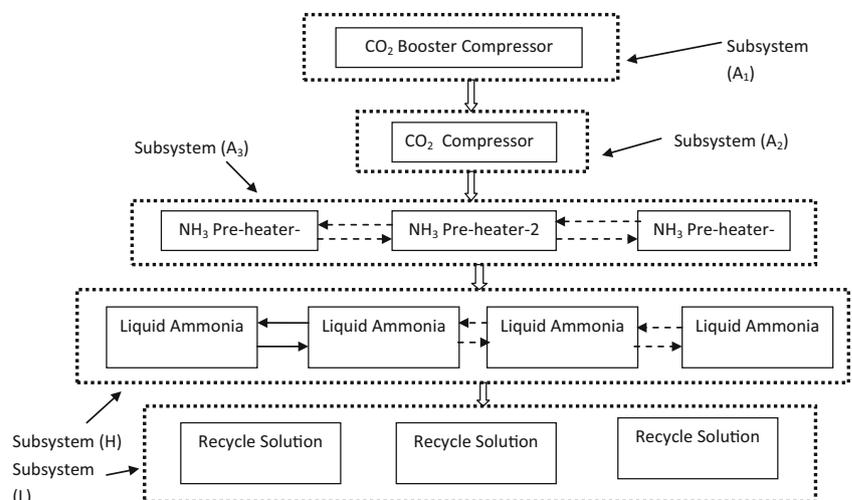

differential equations are derived by using the mnemonic rule as stated by Khanduja et al. (2008). According to the mnemonic rule, the derivative of the probability of every state is equal to the sum of all probability flows which comes from other states to the given state minus the sum of all probability flows which goes out from the given state to the other states. The transition diagram (Fig. 2) depicts a simulation model showing all the possible states of the urea synthesis system.

Thus, the equations for transient state and steady state of the urea synthesis system are derived as follows.

Transient state

Mathematical Eqs. (4)–(17) are developed by applying Markov birth–death process to each state one by one out of 41 states of transition diagram (Fig. 2) as explained by Garg et al. (2010a, b):

$$\left(\frac{d}{dt} + \sum_{i=1}^5 \alpha_i\right) P_0(t) = \beta_1 P_9(t) + \beta_2 P_{10}(t) + \beta_3 P_{11}(t) + \beta_4 P_2(t) + \beta_5 P_1(t) \tag{4}$$

$$\left(\frac{d}{dt} + \sum_{i=1}^5 \alpha_i + \beta_5\right) P_1(t) = \beta_1 P_{12}(t) + \beta_2 P_{13}(t) + \beta_3 P_{14}(t) + \beta_5 P_6(t) + \beta_4 P_3(t) + \alpha_5 P_0(t) \tag{5}$$

$$\left(\frac{d}{dt} + \sum_{i=1}^5 \alpha_i + \beta_4\right) P_2(t) = \beta_1 P_{15}(t) + \beta_2 P_{16}(t) + \beta_3 P_{17}(t) + \beta_4 P_4(t) + \beta_5 P_3(t) + \alpha_4 P_0(t) \tag{6}$$


$$\left(\frac{d}{dt} + \sum_{i=1}^5 \alpha_i + \beta_5 + \beta_4\right) P_3(t) = \beta_1 P_{18}(t) + \beta_2 P_{19}(t) + \beta_3 P_{20}(t) + \beta_4 P_5(t) + \alpha_4 P_1(t) + \alpha_5 P_2(t) \tag{7}$$

$$\left(\frac{d}{dt} + \sum_{i=1}^5 \alpha_i + \beta_4\right) P_4(t) = \beta_1 P_{21}(t) + \beta_2 P_{22}(t) + \beta_3 P_{23}(t) + \beta_4 P_{24}(t) + \beta_5 P_5(t) + \alpha_4 P_2(t) \tag{8}$$

$$\left(\frac{d}{dt} + \sum_{i=1}^5 \alpha_i + \beta_4 + \beta_5\right) P_5(t) = \beta_1 P_{25}(t) + \beta_2 P_{26}(t) + \beta_3 P_{27}(t) + \beta_4 P_{40}(t) + \beta_5 P_8(t) + \alpha_4 P_3(t) + \alpha_5 P_4(t) \tag{9}$$

$$\left(\frac{d}{dt} + \sum_{i=1}^5 \alpha_i + \beta_5\right) P_6(t) = \beta_1 P_{28}(t) + \beta_2 P_{29}(t) + \beta_3 P_{30}(t) + \beta_5 P_{31}(t) + \beta_4 P_7(t) + \alpha_5 P_1(t) \tag{10}$$

Fig. 2 Transition diagram of the urea synthesis system

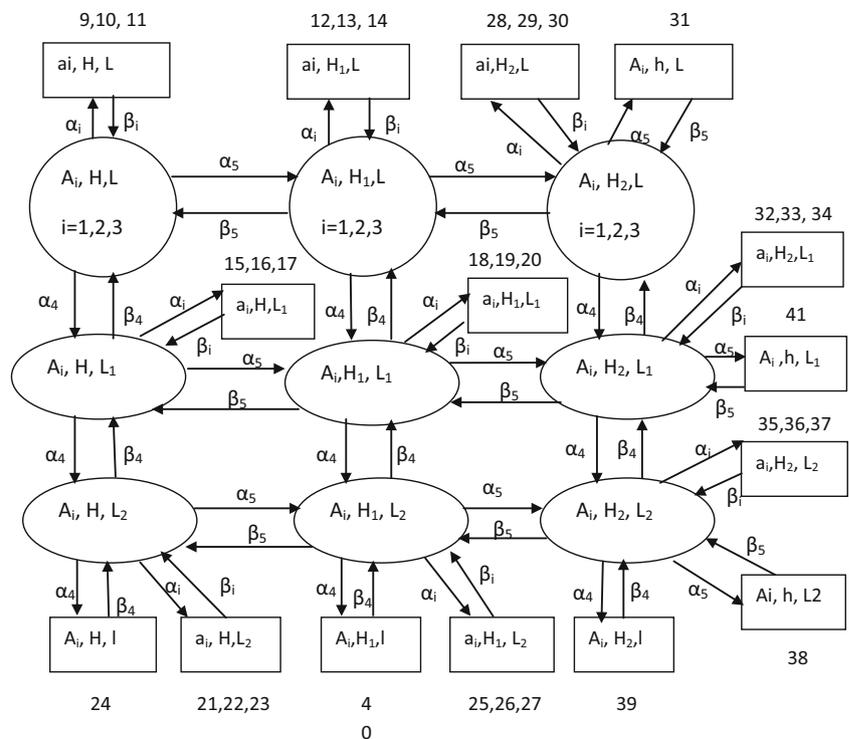

$$\left(\frac{d}{dt} + \sum_{i=1}^5 \alpha_i + \beta_5 + \beta_4\right)P_7(t) = \beta_1P_{32}(t) + \beta_2P_{33}(t) + \beta_3P_{34}(t) + \beta_5P_{41}(t) + \beta_4P_8(t) + \alpha_5P_3(t) + \alpha_4P_6(t) \tag{11}$$

$$\left(\frac{d}{dt} + \sum_{i=1}^5 \alpha_i + \beta_5 + \beta_4\right)P_8(t) = \beta_1P_{35}(t) + \beta_2P_{36}(t) + \beta_3P_{37}(t) + \beta_5P_{39}(t) + \beta_4P_{38}(t) + \alpha_5P_5(t) + \alpha_4P_7(t) \tag{12}$$

$$\left(\frac{d}{dt} + \beta_1\right)P_i(t) = \alpha_1P_j(t), \tag{13}$$

where  $i = 9,12,15,18,21,25,28,32,35$  and  $j = 0,1,2,3,4,5,6,7,8$ , respectively.

$$\left(\frac{d}{dt} + \beta_2\right)P_i(t) = \alpha_2P_j(t), \tag{14}$$

where  $i = 10, 13, 16, 19, 22, 26, 29, 33, 36$  and  $j = 0, 1, 2, 3, 4, 5, 6, 7, 8$ , respectively.

$$\left(\frac{d}{dt} + \beta_3\right)P_i(t) = \alpha_3P_j(t), \tag{15}$$

where  $i = 11, 14, 17, 20, 23, 27, 30, 34, 37$  and  $j = 0, 1, 2, 3, 4, 5, 6, 7, 8$ , respectively.

$$\left(\frac{d}{dt} + \beta_4\right)P_i(t) = \alpha_4P_j(t), \tag{16}$$

where  $i = 24, 40, 39$  and  $j = 4, 5, 8$ , respectively.

$$\left(\frac{d}{dt} + \beta_5\right)P_i(t) = \alpha_5P_j(t), \tag{17}$$

where  $i = 31, 41, 38$  and  $j = 6, 7, 8$ , respectively.

The initial conditions are:

$$P_j(0) = \begin{cases} 1, & \text{if } j = 1 \\ 0, & \text{if } j \neq 1 \end{cases} \tag{18}$$

The system of differential Eqs. (4)–(17) with initial conditions given by Eq. (18) was solved by Runge–Kutta fourth-order method. The numerical computations were carried out by taking time  $t = 0$  to  $t = 360$  days for different choices of failure and repair rates of the subsystems. The data regarding failure and repair rates of all the subsystems were taken from the plant personnel as stated earlier.

Reliability  $R(t)$  of the system is the sum of the reliabilities of the system working under full capacity and reduced state, i.e.,

$$R(t) = P_0(t) + P_1(t) + P_2(t) + P_3(t) \dots + P_8(t). \tag{19}$$

Equation (19) is used to compute the reliability of the urea synthesis system, where  $P_0(t)$  is the probability of the system working with full capacity,  $P_1(t)$  and  $P_6(t)$  are the probability of the system working under cold standby state

and  $P_2(t), P_3(t), P_4(t), P_5(t), P_7(t)$  and  $P_8(t)$  are the probability of the system working with reduced capacity.

Steady state

Arora and Kumar (1997) stated that in process plant or industries, the management is interested in getting the long-run availability of the system. The steady-state probabilities of the system are obtained by imposing the following restrictions:  $d/dt \rightarrow 0$ , as  $t \rightarrow \infty$ . Thus, the long-run availability, i.e.,  $A(\infty)$  of the urea synthesis system is obtained by putting derivative of all probabilities equal to zero, i.e.,

$$\beta_1P_i = \alpha_1P_j, \tag{20}$$

where  $i = 9,12,15,18,21,25,28,32,35$  and  $j = 0,1,2,3,4,5,6,7,8$  respectively.

$$\beta_2P_i = \alpha_2P_j, \tag{21}$$

where  $i = 9,12,15,18,21,25,28,32,35$  and  $j = 0,1,2,3,4,5,6,7,8$ , respectively.

$$\beta_3P_i = \alpha_3P_j, \tag{22}$$

where  $i = 9,12,15,18,21,25,28,32,35$  and  $j = 0,1,2,3,4,5,6,7,8$ . respectively.

$$\beta_4P_i = \alpha_4P_j, \tag{23}$$

where  $i = 24, 40, 39$  and  $j = 4, 5, 8$ , respectively.

$$\beta_5P_i = \alpha_5P_j, \tag{24}$$

where  $i = 31, 41, 38$  and  $j = 6, 7, 8$ , respectively.

Thus, by putting the values of probabilities from Eqs. (20)–(24) in Eqs. (4)–(17),

finally, we get

$$C_1P_0 = \beta_5P_1 + \beta_4P_2 \quad \text{where } C_1 = \alpha_5 + \alpha_4, \tag{25}$$

$$C_2P_1 = \beta_5P_6 + \beta_4P_3 + \alpha_5P_0 \quad \text{where } C_2 = C_1 + \beta_5, \tag{26}$$

$$C_3P_2 = \beta_5P_3 + \alpha_4P_0 + \beta_4P_4 \quad \text{where } C_3 = C_1 + \beta_4, \tag{27}$$

$$C_4P_3 = \alpha_4P_1 + \alpha_5P_2 + \beta_5P_7 + \beta_4P_5 \quad \text{where } C_4 = C_3 + \beta_5, \tag{28}$$

$$C_5P_4 = \beta_5P_5 + \alpha_4P_2 \quad \text{where } C_5 = \alpha_5 + \beta_4, \tag{29}$$

$$C_6P_5 = \beta_5P_8 + \alpha_4P_3 + \alpha_5P_4 \quad \text{where } C_6 = C_5 + \beta_5, \tag{30}$$

$$C_7P_6 = \beta_4P_7 + \alpha_1P_1 \quad \text{where } C_7 = \alpha_4 + \beta_5, \tag{31}$$

$$C_8P_7 = \beta_4P_8 + \alpha_4P_6 + \alpha_5P_3 \quad \text{where } C_8 = C_7 + \beta_4, \tag{32}$$

$$C_9P_8 = \alpha_4P_7 + \alpha_5P_5 \quad \text{where } C_9 = \beta_5 + \beta_4. \tag{33}$$

Solving these equations recursively,

$$P_1 = C_{17}P_0, \tag{34}$$

where  $C_{17} = C_{14} + C_{15} + C_{16}/(1 + C_{12}) + C_{11}/(C_{13}/(1 + C_{12}) + C_{10});$

$$P_2 = C_{19}P_0, \tag{35}$$

where  $C_{19} = (C_1 - (\beta_5 C_{16}))/\beta_4;$

$$P_3 = C_{18}P_0, \tag{36}$$

where  $C_{18} = (C_{13}/(1 + C_{12})C_{17}) - C_{16};$

$$P_4 = C_{21}P_0, \tag{37}$$

where  $C_{21} = ((C_3 C_{19}) - \alpha_4 - (\beta_5 C_{18}))/C_3;$

$$P_5 = C_{22}P_0, \tag{38}$$

where  $C_{22} = ((C_5 C_{21}) - (\alpha_4 C_{19}))/\beta_5;$

$$P_6 = C_{20}P_0, \tag{39}$$

where  $C_{20} = ((C_2 C_{17}) - \alpha_5 - (\beta_4 C_{18}))/\beta_5;$

$$P_7 = C_{23}P_0, \tag{40}$$

where  $C_{23} = ((C_7 C_{20}) - (\alpha_5 C_{17}))/\beta_5;$

$$P_8 = C_{24}P_0, \tag{41}$$

where  $C_{24} = ((\alpha_4 C_{23}) + (\alpha_5 C_{22})).$

$$C_{31} = (\alpha_4/C_4 - (\alpha_5 C_5)/(C_4 \beta_4)) + (((C_7 C_2) + (\alpha_5 \beta_5))/\beta_4) - C_5 + \alpha_4,$$

$$C_{10} = 1/(1 + C_7 \beta_4 + ((\beta_4 C_5)/C_3)) C_{31},$$

$$C_{32} = ((C_7 \alpha_5)/\beta_4 + (\alpha_5 C_1 - (((\beta_4 C_5 \alpha_4)/C_3) - (C_5 C_1))/\beta_5),$$

$$C_{11} = 1/(1 + C_7 \beta_4 + ((\beta_4 C_5)/C_3)) C_{32},$$

$$C_{12} = [(C_8 C_7)/(\alpha_5 \alpha_3) + (\alpha_4 \beta_4)/(\alpha_5 \beta_5) - (\alpha_5 C_5)/C_3 - (\beta_4 \alpha_4)/((\alpha_5 \beta_5 C_9)) ((C_4 + ((\beta_4 C_5)/C_3))],$$

$$C_{13} = [(C_2/(\alpha_5 \beta_5)) (((C_8 C_7 \beta_5)/\beta_4) - (\alpha_4)) - ((C_8/\beta_4) + ((\alpha_5 \alpha_4)/\beta_4) + (\alpha_4/C_9)],$$

$$C_{14} = (1/(\beta_4 \beta_5)) ((C_8 C_7) + (C_1 \alpha_5 \alpha_4)),$$

$$C_{15} = ((\alpha_4 \beta_4 \beta_4)/(\beta_5 \beta_5 C_9 \alpha_5)) ((\alpha_5 C_5)/C_3 - C_1),$$

$$C_{16} = (\alpha_4/\beta_5) (1 + ((\alpha_5 C_5)/C_3) + (C_1/C_9)).$$

The probability of full working capacity, i.e.,  $P_0$  is determined by using normalizing condition: (i.e., sum of the probabilities of all working states, reduced capacity and failed states is equal to 1), i.e.,

$$\sum_{i=0}^{41} P_i = 1 \quad \text{i.e. } P_0 N = 1$$

$$P_0 = N^{-1},$$

where

$$N = [(1 + C_{17} + C_{18} + C_{19} + C_{20} + C_{21} + C_{22} + C_{23} + C_{24})(1 + \alpha_1/\beta_1 + \alpha_2/\beta_2 + \alpha_3/\beta_3) + \alpha_4/\beta_4) (1 + C_{21} + C_{24} + C_{22}) + \alpha_5/\beta_5(1 + C_{20} + C_{24} + C_{23})].$$

Now, the steady state availability  $A(\infty)$  of urea synthesis system may be obtained as summation of all working and reduced capacity state probabilities, i.e.,

$$A(\infty) = \sum_{i=0}^8 P_i,$$

$$A(\infty) = P_0 + P_1 + P_2 + P_3 + P_4 + P_5 + P_6 + P_7 + P_8,$$

$$A(\infty) = (1 + C_{17} + C_{18} + C_{19} + C_{20} + C_{21} + C_{22} + C_{23} + C_{24})/N,$$

$$A(\infty) = (1 + C_{17} + C_{18} + C_{19} + C_{20} + C_{21} + C_{22} + C_{23} + C_{24})/[(1 + C_{17} + C_{18} + C_{19} + C_{20} + C_{21} + C_{22} + C_{23} + C_{24})(1 + \alpha_1/\beta_1 + \alpha_2/\beta_2 + \alpha_3/\beta_3) + \alpha_4/\beta_4)(1 + C_{21} + C_{24} + C_{22}) + \alpha_5/\beta_5(1 + C_{20} + C_{24} + C_{23})]. \tag{42}$$

Eq. (42) is used to get the long-run availability of the urea synthesis system.

### Performance analysis of the system

This section includes the following

- The computation of long-run availability of the system.
- The computation of reliability and mean time between failures (MTBF) of the system.

#### Long-run availability of the system

The long-run availability of the system is computed by using Eq. (42), and the effect of change in failure and repair rates of subsystems on long-run availability of the system is presented in Tables 1, 2, 3, 4 and 5.

**Table 1** Effect of failure and repair rates of subsystem  $A_1$  on the long-run availability of the system

$\beta_1$	$\alpha_1$			
	0.004	0.005	0.006	0.007
0.35	0.933521	0.931038	0.928567	0.92611
0.4	0.934767	0.932588	0.930419	0.92826
0.45	0.935739	0.933798	0.931864	0.929938
0.5	0.936518	0.934767	0.933023	0.931285

**Table 2** Effect of failure and repair rates of subsystem  $A_2$  on the long-run availability of the system

$\beta_2$	$\alpha_2$			
	0.004	0.005	0.006	0.007
0.05	0.907207	0.891039	0.875438	0.860374
0.1	0.941367	0.932588	0.923971	0.915512
0.15	0.953333	0.947312	0.941367	0.935496
0.2	0.959431	0.954850	0.950313	0.945819

**Table 3** Effect of failure and repair rates of subsystem  $A_3$  on the long-run availability of the system

$\beta_3$	$\alpha_3$			
	0.0005	0.001	0.0015	0.002
0.45	0.933326	0.932395	0.931466	0.930539
0.5	0.933422	0.932588	0.931755	0.930924
0.55	0.933502	0.932746	0.931992	0.93124
0.6	0.933568	0.932878	0.93219	0.931503

**Table 4** Effect of failure and repair rates of subsystem H on long-run availability of the system

$\beta_4$	$\alpha_4$			
	0.001	0.002	0.003	0.004
0.05	0.933236	0.933063	0.932874	0.932670
0.1	0.932999	0.932588	0.932178	0.931768
0.15	0.932960	0.932554	0.932150	0.931748
0.2	0.932935	0.932548	0.932165	0.931784

**Table 5** Effect of failure and repair rates of subsystem L on the long-run availability of the system

$\beta_5$	$\alpha_5$			
	0.003	0.004	0.005	0.006
0.35	0.933288	0.931576	0.929873	0.92818
0.4	0.934087	0.932588	0.931096	0.929612
0.45	0.934719	0.933386	0.932058	0.930736
0.5	0.935234	0.934033	0.932836	0.931644

*Effect of failure and repair rates of subsystem  $A_1$  on long-run availability of the system*

The effect of failure and repair rates of subsystem  $A_1$  on long-run availability of the system is studied by varying their values as  $\alpha_1 = 0.004, 0.005, 0.006, 0.007$  and  $\beta_1 = 0.35, 0.4, 0.45, 0.5$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_2 = 0.005,$

$\alpha_3 = 0.001, \alpha_4 = 0.002, \alpha_5 = 0.004, \beta_2 = 0.1, \beta_3 = 0.5, \beta_4 = 0.1, \beta_5 = 0.4$ . The long-run availability of the system is calculated using these data and the results are shown in Table 1. Table 1 shows that increase in failure rate ( $\alpha_1$ ) of subsystem  $A_1$  causes decrease in long-run availability of the system from 0.794 to 0.559 % approximately, but increase in repair rate ( $\beta_1$ ) of subsystem  $A_1$  causes increase in long-run availability of the system from 0.32 to 0.56 %.

*Effect of failure and repair rates of subsystem  $A_2$  on long-run availability of the system*

The effect of failure and repair rates of subsystem  $A_2$  on long-run availability of the system is studied by varying their values as  $\alpha_2 = 0.004, 0.005, 0.006, 0.007$  and  $\beta_2 = 0.05, 0.1, 0.15, 0.2$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_1 = 0.005, \alpha_3 = 0.001, \alpha_4 = 0.002, \alpha_5 = 0.004, \beta_1 = 0.4, \beta_3 = 0.5, \beta_4 = 0.1, \beta_5 = 0.4$ . Table 2 shows that increase in failure rate ( $\alpha_2$ ) of subsystem  $A_2$  causes decrease in long-run availability of the system from 5.16 to 1.418 % approximately, but increase in repair rate ( $\beta_2$ ) of subsystem  $A_2$  causes increase in long-run availability of the system from 5.76 to 9.93 %.

*Effect of failure and repair rates of subsystem  $A_3$  on long-run availability of the system*

The effect of failure and repair rates of subsystem  $A_3$  on long-run availability of the system is studied by varying their values as  $\alpha_3 = 0.0005, 0.001, 0.0015, 0.002$  and  $\beta_3 = 0.4, 0.5, 0.6, 0.7$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_1 = 0.005, \alpha_2 = 0.005, \alpha_4 = 0.002, \alpha_5 = 0.004, \beta_1 = 0.4, \beta_2 = 0.1, \beta_4 = 0.1, \beta_5 = 0.4$ . Table 3 shows that increase in failure rate ( $\alpha_3$ ) of subsystem  $A_3$  causes decrease in long-run availability of the system from 0.299 to 0.221 % approximately, but increase in repair rate ( $\beta_3$ ) of subsystem  $A_3$  causes increase in long-run availability of the system from 0.03 to 0.10 %.

*Effect of failure and repair rates of subsystem H on long-run availability of the system*

The effect of failure and repair rates of subsystem H on long-run availability of the system is studied by varying their values as  $\alpha_4 = 0.001, 0.002, 0.003, 0.004$  and  $\beta_4 = 0.05, 0.1, 0.15, 0.2$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_1 = 0.005, \alpha_2 = 0.005, \alpha_3 = 0.001, \alpha_5 = 0.004, \beta_1 = 0.4, \beta_2 = 0.1, \beta_3 = 0.5, \beta_5 = 0.4$ . Table 4 shows that increase in failure rate ( $\alpha_4$ ) of subsystem H causes decrease in long-run availability of the system from 0.06 to 0.123 % approximately, but increase in repair rate ( $\beta_4$ ) of subsystem H

causes decrease in long-run availability of the system from 0.032 to 0.095 %.

*Effect of failure and repair rates of subsystem L on long-run availability of the system*

The effect of failure and repair rates of subsystem L on long-run availability of the system is studied by varying their values as  $\alpha_5 = 0.003, 0.004, 0.005, 0.006$  and  $\beta_5 = 0.3, 0.4, 0.5, 0.6$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_1 = 0.005, \alpha_2 = 0.005, \alpha_3 = 0.001, \alpha_4 = 0.002, \beta_1 = 0.4, \beta_2 = 0.1, \beta_3 = 0.5, \beta_4 = 0.1$ . Table 5 shows that increase in failure rate ( $\alpha_5$ ) of subsystem L causes decrease in long-run availability of the system from 0.547 to 0.384 % approximately, but increase in repair rate ( $\beta_5$ ) of subsystem L causes increase in long-run availability of the system from 0.21 to 0.37 %.

Reliability of the system

Some methods such as Laplace transformation, Lagrange’s and matrix methods are available to solve the governing differential equations, but these methods are not advisable for use if the system is complex and has a large number of differential equations. Therefore, Runge–Kutta fourth-order method is used to solve these differential equations.

Effect of failure and repair rates of subsystem A<sub>1</sub> on the reliability of the system

The effect of failure rates of subsystem A<sub>1</sub> on the reliability of the system is studied by varying their values as  $\alpha_1 = 0.004, 0.005, 0.006, 0.007$  at  $\beta_1 = 0.4$ . The failure

and repair rates of other subsystems are kept constant as  $\alpha_2 = 0.005, \alpha_3 = 0.001, \alpha_4 = 0.002, \alpha_5 = 0.004, \beta_2 = 0.1, \beta_3 = 0.5, \beta_4 = 0.1, \beta_5 = 0.4$ . The reliability of the system is calculated with these data and the results are shown in Table 6. This table shows that the reliability of the system decreases by 0.019 % approximately with the increase of time. However, it decreases from 0.7032 to 0.7015 % approximately and MTBF decreases from 339 to 336.7 days when the failure rate varies from 0.004 to 0.007.

The effect of repair rates of subsystem A<sub>1</sub> on the reliability of the system is studied by varying their values as  $\beta_1 = 0.3, 0.4, 0.5, 0.6$  at  $\alpha_1 = 0.005$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_2 = 0.005, \alpha_3 = 0.001, \alpha_4 = 0.002, \alpha_5 = 0.004, \beta_2 = 0.1, \beta_3 = 0.5, \beta_4 = 0.1, \beta_5 = 0.4$ . The reliability of the system is calculated with these data and the results are shown in Table 6. This table shows that the reliability of the system decreases by 0.185 % approximately with the increase of time. However, it increases from 0.7864 to 0.790 % approximately and MTBF increases from 336.97 to 339.62 days when the failure rate varies from 0.3 to 0.6.

Effect of failure and repair rates of subsystem A<sub>2</sub> on the reliability of the system

The effect of failure rates of subsystem A<sub>2</sub> on the reliability of the system is studied by varying their values as  $\alpha_2 = 0.004, 0.005, 0.006, 0.007$  at  $\beta_2 = 0.1$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_1 = 0.005, \alpha_3 = 0.001, \alpha_4 = 0.002, \alpha_5 = 0.004, \beta_1 = 0.4, \beta_3 = 0.5, \beta_4 = 0.1, \beta_5 = 0.4$ . The reliability of the system is calculated with these data and the results are shown in Table 7. This table shows that the reliability of

**Table 6** Effect of failure and repair rates of subsystem A<sub>1</sub> on the reliability of the system

Days	Failure rate of subsystem A <sub>1</sub> ( $\alpha_1$ )				Repair rate of subsystem A <sub>1</sub> ( $\beta_1$ )			
	0.004	0.005	0.006	0.007	0.3	0.4	0.5	0.6
30	0.943606	0.941382	0.939172	0.936971	0.937691	0.941382	0.943608	0.945100
60	0.941729	0.939517	0.937315	0.935124	0.935853	0.939517	0.941729	0.943210
90	0.941667	0.939455	0.937254	0.935063	0.935792	0.939455	0.941667	0.943147
120	0.941684	0.939472	0.937271	0.935080	0.935809	0.939472	0.941684	0.943164
150	0.941704	0.939492	0.937291	0.935100	0.935829	0.939492	0.941704	0.943185
180	0.941725	0.939513	0.937311	0.935120	0.935849	0.939513	0.941725	0.943205
210	0.941745	0.939533	0.937331	0.935140	0.935869	0.939533	0.941745	0.943226
240	0.941766	0.939553	0.937352	0.935160	0.935890	0.939553	0.941766	0.943246
270	0.941786	0.939574	0.937372	0.935180	0.935910	0.939574	0.941786	0.943267
300	0.941806	0.939594	0.937392	0.935201	0.935930	0.939594	0.941806	0.943287
330	0.941827	0.939615	0.937413	0.935221	0.935950	0.939615	0.941827	0.943308
360	0.941847	0.939635	0.937433	0.935241	0.935970	0.939635	0.941847	0.943328
MTBF	339.09	338.29	337.49	336.71	336.97	338.29	339.087	339.62

**Table 7** Effect of failure and repair rates of subsystem  $A_2$  on the reliability of the system

Days	Failure rate of subsystem $A_2$ ( $\alpha_2$ )				Repair rate of subsystem $A_2$ ( $\beta_2$ )			
	0.004	0.005	0.006	0.007	0.05	0.1	0.15	0.2
30	0.949960	0.941382	0.932946	0.924643	0.914221	0.941382	0.954649	0.962054
60	0.948413	0.939517	0.930784	0.922210	0.900550	0.939517	0.954377	0.962026
90	0.948364	0.939455	0.930712	0.922130	0.897933	0.939455	0.954395	0.962046
120	0.948382	0.939472	0.930728	0.922146	0.897444	0.939472	0.954416	0.962068
150	0.948403	0.939492	0.930748	0.922165	0.897365	0.939492	0.954437	0.962089
180	0.948423	0.939513	0.930768	0.922185	0.897365	0.939513	0.954458	0.962110
210	0.948444	0.939533	0.930788	0.922204	0.897380	0.939533	0.954479	0.962132
240	0.948465	0.939553	0.930808	0.922224	0.897398	0.939553	0.954500	0.962153
270	0.948485	0.939574	0.930828	0.922244	0.897416	0.939574	0.954521	0.962174
300	0.948506	0.939594	0.930848	0.922263	0.897435	0.939594	0.954542	0.962196
330	0.948527	0.939615	0.930868	0.922283	0.897453	0.939615	0.954563	0.962217
360	0.948548	0.939635	0.930888	0.922303	0.897472	0.939635	0.954584	0.962238
MTBF	313.03	338.29	335.15	332.07	323.68	338.29	343.62	346.36

**Table 8** Effect of failure and repair rates of subsystem  $A_3$  on the reliability of the system

Days	Failure rate of subsystem $A_3$ ( $\alpha_3$ )				Repair rate of subsystem $A_3$ ( $\beta_3$ )			
	0.0005	0.001	0.0015	0.002	0.4	0.5	0.6	0.7
30	0.942269	0.941382	0.940496	0.939612	0.940940	0.941382	0.941682	0.941893
60	0.940400	0.939517	0.938635	0.937755	0.939075	0.939517	0.939811	0.940021
90	0.940339	0.939455	0.938574	0.937694	0.939014	0.939455	0.939750	0.939960
120	0.940356	0.939472	0.938590	0.937710	0.939031	0.939472	0.939766	0.939977
150	0.940376	0.939492	0.938611	0.937730	0.939051	0.939492	0.939787	0.939998
180	0.940396	0.939513	0.938631	0.937751	0.939072	0.939513	0.939807	0.940017
210	0.940417	0.939533	0.938651	0.937771	0.939092	0.939533	0.939828	0.940038
240	0.940437	0.939553	0.938672	0.937791	0.939112	0.939553	0.939848	0.940059
270	0.940457	0.939574	0.938692	0.937812	0.939133	0.939574	0.939868	0.940079
300	0.940478	0.939594	0.938712	0.937832	0.939153	0.939594	0.939889	0.940099
330	0.940498	0.939615	0.938733	0.937852	0.939173	0.939615	0.939909	0.940120
360	0.940519	0.939635	0.938753	0.937872	0.939194	0.939635	0.939929	0.940140
MTBF	338.61	338.29	337.98	337.66	338.13	338.29	338.40	338.72

the system decreases from 0.253 to 0.149 % approximately with the increase of time. However, it decreases from 2.76 to 2.66 % approximately and MTBF decreases from 332 to 313 days when the failure rate varies from 0.004 to 0.007.

The effect of repair rates of subsystem  $A_2$  on the reliability of the system is studied by varying their values as  $\beta_2 = 0.05, 0.1, 0.15, 0.2$  at  $\alpha_2 = 0.005$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_1 = 0.005, \alpha_3 = 0.001, \alpha_4 = 0.002, \alpha_5 = 0.004, \beta_1 = 0.4, \beta_3 = 0.5, \beta_4 = 0.1, \beta_5 = 0.4$ . The reliability of the system is calculated with these data and the results are shown in Table 7. This table shows that the reliability of the system decreases from 1.832 to 0.007 % approximately with the increase of time. However, it increases from 5.23

to 7.0 % approximately and MTBF increases from 323.68 days to 346.36 days when the repair rate varies from 0.05 to 0.2.

Effect of failure and repair rates of subsystem  $A_3$  on the reliability of the system

The effect of failure rates of subsystem  $A_3$  on the reliability of the system is studied by varying their values as  $\alpha_3 = 0.0005, 0.001, 0.0015, 0.002$  at  $\beta_3 = 0.5$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_1 = 0.005, \alpha_2 = 0.005, \alpha_4 = 0.002, \alpha_5 = 0.004, \beta_1 = 0.4, \beta_2 = 0.1, \beta_4 = 0.1, \beta_5 = 0.4$ . The reliability of the system is calculated with these data and results are

**Table 9** Effect of failure and repair rates of subsystem H on the reliability of the system

Days	Failure rate of subsystem H ( $\alpha_4$ )				Repair rate of subsystem H ( $\beta_4$ )			
	0.001	0.002	0.003	0.004	0.05	0.1	0.15	0.2
30	0.941380	0.941382	0.941379	0.941366	0.941380	0.941382	0.941382	0.941382
60	0.939507	0.939517	0.939517	0.939502	0.939512	0.939517	0.939512	0.939509
90	0.939436	0.939455	0.939464	0.939458	0.939455	0.939455	0.939445	0.939438
120	0.939443	0.939472	0.939491	0.939493	0.939485	0.939472	0.939455	0.939445
150	0.939453	0.939492	0.939521	0.939533	0.939521	0.939492	0.939469	0.939455
180	0.939463	0.939513	0.939551	0.939572	0.939560	0.939513	0.939482	0.939465
210	0.939474	0.939533	0.939581	0.939612	0.939599	0.939533	0.939496	0.939475
240	0.939484	0.939553	0.939611	0.939652	0.939639	0.939553	0.939510	0.939486
270	0.939494	0.939574	0.939641	0.939692	0.939679	0.939574	0.939523	0.939496
300	0.939504	0.939594	0.939671	0.939731	0.939719	0.939594	0.939537	0.939506
330	0.939515	0.939615	0.939702	0.939771	0.939758	0.939615	0.939551	0.939517
360	0.939525	0.939635	0.939732	0.939811	0.939798	0.939635	0.939565	0.939527
MTBF	338.27	338.29	338.31	338.31	338.31	338.29	338.28	338.27

**Table 10** Effect of failure and repair rates of subsystem L on the reliability of the system

Days	Failure rate of subsystem L ( $\alpha_5$ )				Repair rate of subsystem L ( $\beta_5$ )			
	0.003	0.004	0.005	0.006	0.3	0.4	0.5	0.6
30	0.941378	0.941382	0.941388	0.941396	0.941384	0.941382	0.941383	0.941383
60	0.939504	0.939517	0.939533	0.939553	0.939525	0.939517	0.939511	0.939508
90	0.939434	0.939455	0.939483	0.939517	0.939469	0.939455	0.939446	0.939440
120	0.939442	0.939472	0.939511	0.939558	0.939493	0.939472	0.939459	0.939450
150	0.939453	0.939492	0.939543	0.939604	0.939520	0.939492	0.939475	0.939464
180	0.939464	0.939513	0.939574	0.939649	0.939547	0.939513	0.939492	0.939477
210	0.939476	0.939533	0.939606	0.939695	0.939574	0.939533	0.939508	0.939491
240	0.939487	0.939553	0.939638	0.939740	0.939601	0.939553	0.939524	0.939504
270	0.939499	0.939574	0.939669	0.939785	0.939628	0.939574	0.939541	0.939518
300	0.939510	0.939594	0.939701	0.939831	0.939655	0.939594	0.939557	0.939532
330	0.939522	0.939615	0.939733	0.939876	0.939682	0.939615	0.939573	0.939545
360	0.939533	0.939635	0.939765	0.939922	0.939709	0.939635	0.939590	0.939559
MTBF	338.27	338.29	338.31	338.34	338.30	338.29	338.28	338.27

shown in Table 8. This table shows that the reliability of the system decreases by 0.185 % approximately with the increase of time. However, it decreases by 0.282 % approximately and MTBF decreases from 338.6 days to 337.65 days when the failure rate varies from 0.0005 to 0.002.

The effect of repair rates of subsystem  $A_3$  on the reliability of the system is studied by varying their values as  $\beta_3 = 0.4, 0.5, 0.6, 0.7$  at  $\alpha_3 = 0.001$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_1 = 0.005$ ,  $\alpha_2 = 0.005$ ,  $\alpha_4 = 0.002$ ,  $\alpha_5 = 0.004$ ,  $\beta_1 = 0.4$ ,  $\beta_2 = 0.1$ ,  $\beta_4 = 0.1$ ,  $\beta_5 = 0.4$ . The reliability of the system is calculated with these data and results are shown in Table 8. This table shows that the reliability of the system decreases by

0.185 % approximately with the increase of time. However, it increases by 0.101 % approximately and MTBF increases from 338.13 to 338.47 days when the repair rate varies from 0.4 to 0.7.

Effect of failure and repair rates of subsystem H on the reliability of the system

The effect of failure rates of subsystem (H) on the reliability of the system is studied by varying their values as  $\alpha_4 = 0.001, 0.002, 0.003, 0.004$  at  $\beta_4 = 0.1$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_1 = 0.005$ ,  $\alpha_2 = 0.005$ ,  $\alpha_3 = 0.001$ ,  $\alpha_5 = 0.004$ ,  $\beta_1 = 0.4$ ,  $\beta_2 = 0.1$ ,  $\beta_3 = 0.5$ ,  $\beta_5 = 0.4$ . The reliability of

the system is calculated with these data and results are shown in Table 9. This table shows that the reliability of the system decreases from 0.197 to 0.165 % approximately with the increase of time. However, it decreases from 0.013 to 0.001 % and MTBF decreases from 338.32 to 338.27 days when the failure rate varies from 0.001 to 0.004.

The effect of the repair rates of subsystem H on the reliability of the system is studied by varying their values as  $\beta_4 = 0.05, 0.1, 0.15, 0.2$  at  $\alpha_4 = 0.002$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_1 = 0.005, \alpha_2 = 0.005, \alpha_3 = 0.001, \alpha_5 = 0.004; \beta_1 = 0.4, \beta_2 = 0.1, \beta_3 = 0.5, \beta_5 = 0.4$ . The reliability of the system is calculated with these data and results are shown in Table 9. This table shows that the reliability of the system decreases from 0.197 to 0.168 % approximately with the increase of time. However, it increases from 0.0002 to 0.0125 % and MTBF increases from 338.27 to 338.31 days when the repair rate varies from 0.05 to 0.2.

Effect of failure and repair rates of subsystem L on the reliability of the system

The effect of failure rates of subsystem L on the reliability of the system is studied by varying their values as  $\alpha_5 = 0.003, 0.004, 0.005, 0.006$  at  $\beta_5 = 0.4$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_1 = 0.005, \alpha_2 = 0.005, \alpha_3 = 0.001, \alpha_4 = 0.002, \beta_1 = 0.4, \beta_2 = 0.1, \beta_3 = 0.5, \beta_4 = 0.1$ . The reliability of

the system is calculated with these data and results are shown in Table 10. This table shows that the reliability of the system decreases from 0.197 to 0.156 % approximately with the increase of time. However, it decreases from 0.0215 to 0.0019 % approximately and MTBF decreases from 338.34 days to 338.27 days when the failure rate varies from 0.003 to 0.006.

The effect of repair rates of subsystem (L) on the reliability of the system is studied by varying their values as  $\beta_5 = 0.3, 0.4, 0.5, 0.6$  at  $\alpha_5 = 0.004$ . The failure and repair rates of other subsystems are kept constant as  $\alpha_1 = 0.005, \alpha_2 = 0.005, \alpha_3 = 0.001, \alpha_4 = 0.002; \beta_1 = 0.4, \beta_2 = 0.1, \beta_3 = 0.5, \beta_4 = 0.1$ . The reliability of the system is calculated with these data and the results are shown in Table 10. This table shows that the reliability of the system decreases from 0.197 to 0.168 % approximately with the increase of time. However, it increases by 0.008 % and MTBF increases from 338.28 days to 338.27 days when the repair rate varies from 0.3 to 0.6.


Effect of failure and repair rates of subsystems on the long-run availability of the system

Table 11 shows the effect of change in failure and repair rates of subsystems on change (%) in the long-run availability of the system. Table 11 concludes that the change (%) in the long-run availability of the system is maximum with the change in failure and repair rate of subsystem A<sub>2</sub> and the same is shown in Fig. 3.

**Table 11** Effect of failure and repair rates of subsystems on the long-run availability of the system

Change in repair rate	Change in long-run availability of the system with failure rate of subsystems (negative)					Change in long-run availability of the system with repair rate of subsystems (positive)				
	Sub system A <sub>1</sub> ( $\alpha_1$ )	Sub system A <sub>2</sub> ( $\alpha_2$ )	Sub system A <sub>3</sub> ( $\alpha_3$ )	Sub system H ( $\alpha_4$ )	Sub system L ( $\alpha_5$ )	Sub system A <sub>1</sub> ( $\beta_1$ )	Sub system A <sub>2</sub> ( $\beta_2$ )	Sub system A <sub>3</sub> ( $\beta_3$ )	Sub system H ( $\beta_4$ )	Sub system L ( $\beta_5$ )
0.05	0.794	5.162	0.299	0.061	0.547	0.32	5.76	0.03	0.03	0.21
0.1	0.696	2.747	0.268	0.132	0.479	0.40	7.16	0.05	0.06	0.26
0.15	0.620	1.871	0.242	0.130	0.426	0.48	8.55	0.08	0.08	0.32
0.2	0.559	1.419	0.221	0.123	0.384	0.56	9.93	0.10	0.09	0.37

**Fig. 3** Effect of failure and repair rate of subsystems on long-run availability of the system

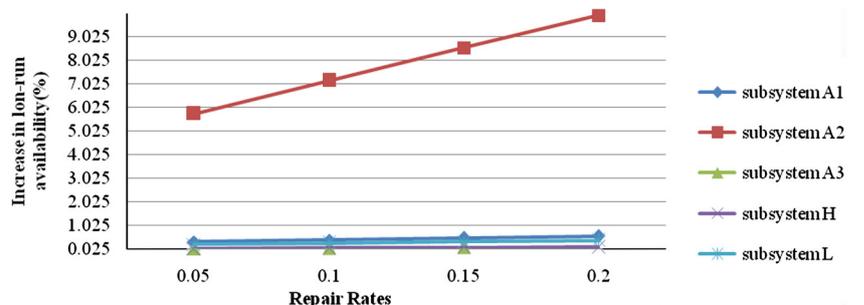

Effect of failure and repair rates of subsystems on the reliability of the system


Table 12 shows the effect of change in failure and repair rates of subsystems on change (%) in reliability of the

system. Table 12 concludes that the change (%) in reliability of the system is maximum with the change in failure and repair rate of subsystem A<sub>2</sub> and the same is shown in Fig. 4a, b. Figure 5 shows the effect of failure and repair rate of subsystem A<sub>2</sub> on system reliability (%).


**Table 12** Effect of failure and repair rates of subsystems on the reliability of the system

Days	Change in reliability of the system with failure rate of subsystems (negative)					Change in reliability of the system with repair rate of subsystems (positive)				
	Sub system A <sub>1</sub> ( $\alpha_1$ )	Sub system A <sub>2</sub> ( $\alpha_2$ )	Sub system A <sub>3</sub> ( $\alpha_3$ )	Sub system H ( $\alpha_4$ )	Sub system L ( $\alpha_5$ )	Sub system A <sub>1</sub> ( $\beta_1$ )	Sub system A <sub>2</sub> ( $\beta_2$ )	Sub system A <sub>3</sub> ( $\beta_3$ )	Sub system H ( $\beta_4$ )	Sub system L ( $\beta_5$ )
30	0.703	2.665	0.2820	0.001	0.002	0.790	5.232	0.1013	0.0002	0.000
60	0.701	2.763	0.2813	0.000	0.005	0.786	6.826	0.1007	0.0003	0.002
90	0.701	2.766	0.2813	0.002	0.009	0.786	7.140	0.1007	0.0018	0.003
120	0.701	2.766	0.2813	0.005	0.012	0.786	7.201	0.1008	0.0042	0.005
150	0.701	2.766	0.2813	0.008	0.016	0.786	7.213	0.1008	0.0071	0.006
180	0.701	2.767	0.2813	0.012	0.020	0.786	7.215	0.1007	0.0101	0.007
210	0.701	2.767	0.2813	0.015	0.023	0.786	7.216	0.1008	0.0132	0.009
240	0.701	2.767	0.2813	0.018	0.027	0.786	7.216	0.1008	0.0163	0.010
270	0.701	2.767	0.2813	0.021	0.031	0.786	7.216	0.1007	0.0194	0.012
300	0.701	2.767	0.2813	0.024	0.034	0.786	7.216	0.1007	0.0226	0.013
330	0.701	2.767	0.2814	0.027	0.038	0.786	7.216	0.1008	0.0257	0.015
360	0.701	2.767	0.2814	0.030	0.041	0.786	7.217	0.1008	0.0288	0.016

**Fig. 4 a** Effect of failure rate of subsystems on the reliability of the system. **b** Effect of repair rate of subsystems on the reliability of the system

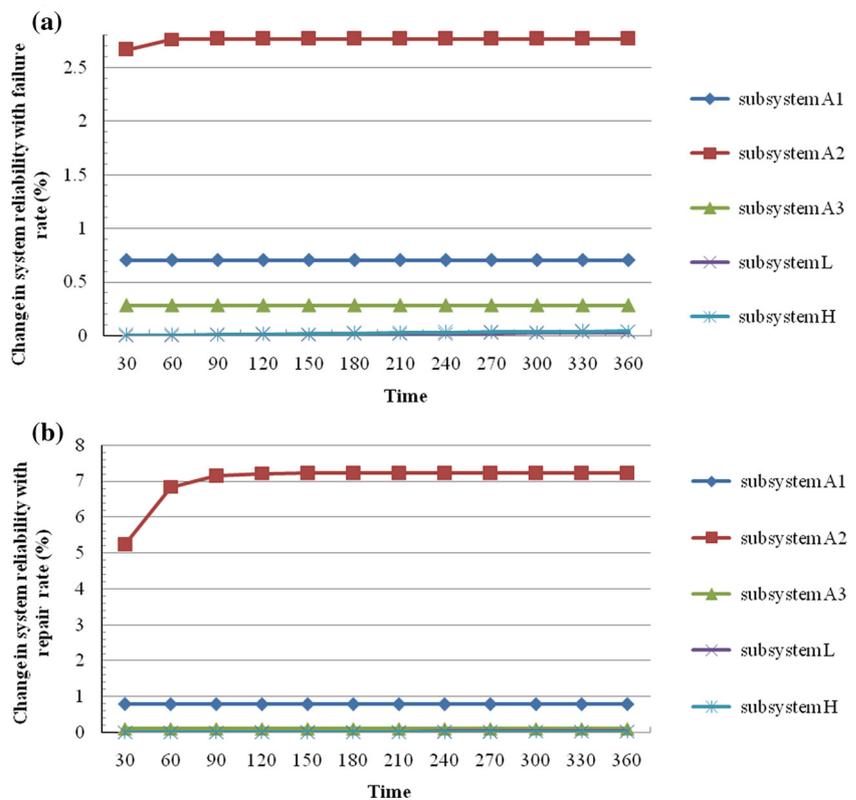

**Fig. 5** Effect of failure and repair rate of subsystem  $A_2$  on system reliability (%)

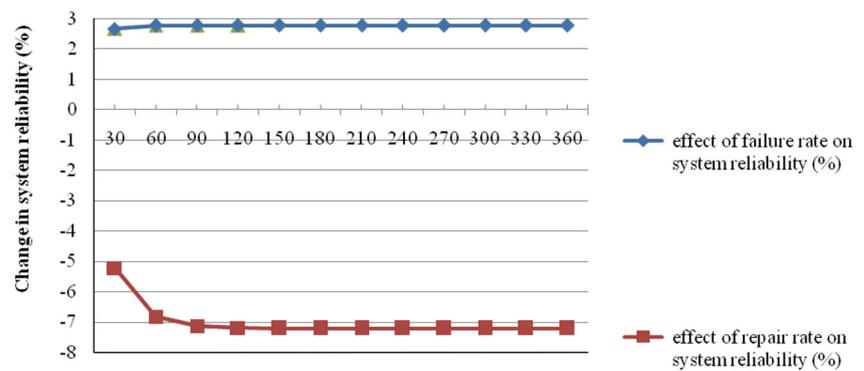

## Discussion and conclusion

The proposed method is easy for use for in the complex system having a large number of differential equations and it helps to compute the long-run availability, reliability and mean time between failures (MTBF) of the urea synthesis system of the fertilizer plant. Table 11 concludes that the long-run availability of the system improved from 5.162 to 9.93 %, while Table 12 concludes that the reliability of the system improved from 2.767 to 7.217 % by controlling the failure rate and repair rate of subsystem  $A_2$ . Thus, the long-run availability and reliability of the system can be improved significantly by the proper maintenance planning of subsystem  $A_2$ . The other subsystems also affect the long-run availability and reliability of the system, but these are lesser effective than subsystem  $A_2$ . These findings of this paper are discussed with the management of the plant and these results are found to be highly beneficial for the performance evaluation and to enhance the production and quality of urea.

**Open Access** This article is distributed under the terms of the Creative Commons Attribution License which permits any use, distribution, and reproduction in any medium, provided the original author(s) and the source are credited.

## References

- Ahmed Q, Faisal IK, Syed AR (2014) A risk-based availability estimation using Markov method. *Int J Qual Reliab Manage* 31(2):106–128
- Arora N, Kumar D (1997) Availability analysis of steam and power generation system in thermal power plant. *Microelectron Reliab* 37(5):795–799
- Bhamare SS, Yadav OP, Rathore A (2008) Evolution of reliability engineering discipline over the last six decades: a comprehensive review. *Int J Reliab Saf* 1(4):377–410
- Bradley ML, Dawson R (1998) The cost of unreliability: a case study. *J Qual Maint Eng* 4(3):212–218
- Dhillon BS, Singh C (1981) *Engineering reliability: new techniques and applications*. Wiley, New York
- Dhople SV, DeVilleville L, Domínguez-García AD (2014) A Stochastic hybrid systems framework for analysis of Markov reward models. *Reliab Eng Syst Saf* 123(3):158–170
- Garg D, Kumar K, Singh J (2010a) Availability analysis of a cattle feed plant using matrix method. *Int J Eng* 3(2):201–219
- Garg S, Singh J, Singh DV (2010b) Availability analysis of crank-case manufacturing in a two-wheeler automobile industry. *Appl Math Model* 34:1672–1683
- Gupta S, Tewari PC (2011) Simulation modeling in a availability thermal power plant. *J Eng Sci Technol Rev* 4(2):110–117
- Kadiyan S, Garg RK, Gautam R (2012) Reliability and availability analysis of uncaser system in a brewery plant. *Int J Res Mech Eng Technol* 2(2):7–11
- Khanduja R, Tewari PC, Kumar D (2008) Availability analysis of bleaching system of a paper plant. *J Ind Eng* 32(1):24–29
- Khanduja R, Tewari PC, Kumar D (2012) Steady state behavior and maintenance planning of bleaching system in a paper plant. *Int J Ind Eng* 7(12):39–44
- Kiilunen J, Frisk L (2014) Reliability analysis of an ACA attached flex-on-board assembly for industrial application. *Solder Surf Mount Technol* 26(2):62–70
- Kumar V, Mudgil V (2014) Availability optimization of ice cream making unit of milk plant using genetic algorithm. *Int J Manag Bus Stud* 4(3):17–19
- Kumar S, Tewari PC (2008) Development of performance evaluating model for CO-Shift conversion system in the fertilizer plant. *Int J Eng Res Ind Appl* 1(6):369–382
- Kumar S, Tewari PC (2009) Simulation model for evaluating the performance of urea decomposition system in a fertilizer plant. *Int J Ind Eng Pract* 1(1):10–14
- Kumar S, Tewari PC (2011) Mathematical modeling and performance optimization of CO<sub>2</sub> cooling system of a fertilizer plant. *Int J Ind Eng Comput* 2:689–698
- Kumar D, Singh J, Pandey PC (1989) Availability analysis of the washing system in the paper industry. *Microelectron Reliab* 29:775–778
- Kumar D, Singh J, Pandey PC (1993) Operational behavior and profit function for a bleaching and screening system in the paper industry. *Microelectron Reliab* 33:1101–1105
- Kumar S, Tewari PC, Sharma R (2007) Simulated availability of CO<sub>2</sub> cooling system in a fertilizer plant. *Ind Eng J (Indian Inst Ind Eng, Mumbai)* 36(10):19–23
- Kumar R, Sharma AK, Tewari PC (2011) Performance modeling of furnace draft air cycle in a thermal power plant. *Int J Eng Sci Technol* 3(8):6792–6798
- Singh P, Goyal A (2013) Behavior analysis of a biscuit making plant using Markov regenerative modeling. *Int J Theor Appl Res Mech Eng* 2(3):148–152

Srinath LS (1994) Reliability Engineering. East-West Press Pvt. Ltd, India

Tewari PC, Khanduja R, Gupta M (2012) performance enhancement for crystallization unit of a sugar plant using genetic algorithm. *J Ind Eng Int* 8(1):1–6

**Anil Kr. Aggarwal** is Director at Rattan Institute of Technology and Management, Village Saveli, Hodal, Haryana (India) affiliated to M.D. University, Rohtak (Haryana). He received his B.E. (Mech.) from Jamia Millia Islamia, New Delhi (India). He received his M.Tech. (Production) from GNDEC, Ludhiana, Punjab. He is perusing his Ph.D. in mechanical engineering from YMCA University of Science and Technology, Faridabad (India). He has 12 years of experience in teaching.

**Sanjeev Kumar** is Associate Professor in the Department of Mechanical Engineering at the YMCA University of Science and Technology, Faridabad (India). He received his Ph.D. in industrial engineering from the National Institute of Technology, Kurukshetra, Haryana (India) He has 15 years of experience in teaching and research. He has published and presented about 40 research papers in international and national journals/conferences.

Expertise: industrial engineering, maintenance engineering and production engineering.

**Vikram Singh** is Associate Professor in the Department of Mechanical Engineering at the YMCA University of Science and Technology, Faridabad (India). He received his B.Tech. (Mech.) from REC Kurukshetra (presently known as NIT Kurukshetra). He received his M.E. (Mech.) from Punjab Engineering College, Punjab (India). He received his Ph.D. in mechanical engineering from M.D. University, Rohtak, Haryana (India). He has 15 years of experience in teaching and research. He has published and presented about 30 research papers in international and national journals/conferences.

Expertise: quality management, manufacturing quality, service quality, supply chain management and operation management.

**Tarun Kr. Garg** is Associate Professor in the Department of Mathematics Satyawati College, Ashok Vihar, Delhi (India). He received his B.Sc. and M.Sc. from M.D. University Rohtak, Haryana and Ph.D. from Jamia Millia Islamia University, India. He has 22 years of experience in teaching and research. He has published and presented about 37 research papers in international and national journals/conferences.

Expertise: operation research, reliability engineering, fuzzy reliability, etc.

